


Skaneateles Lake Water Service Illustration

Illustration is not to scale

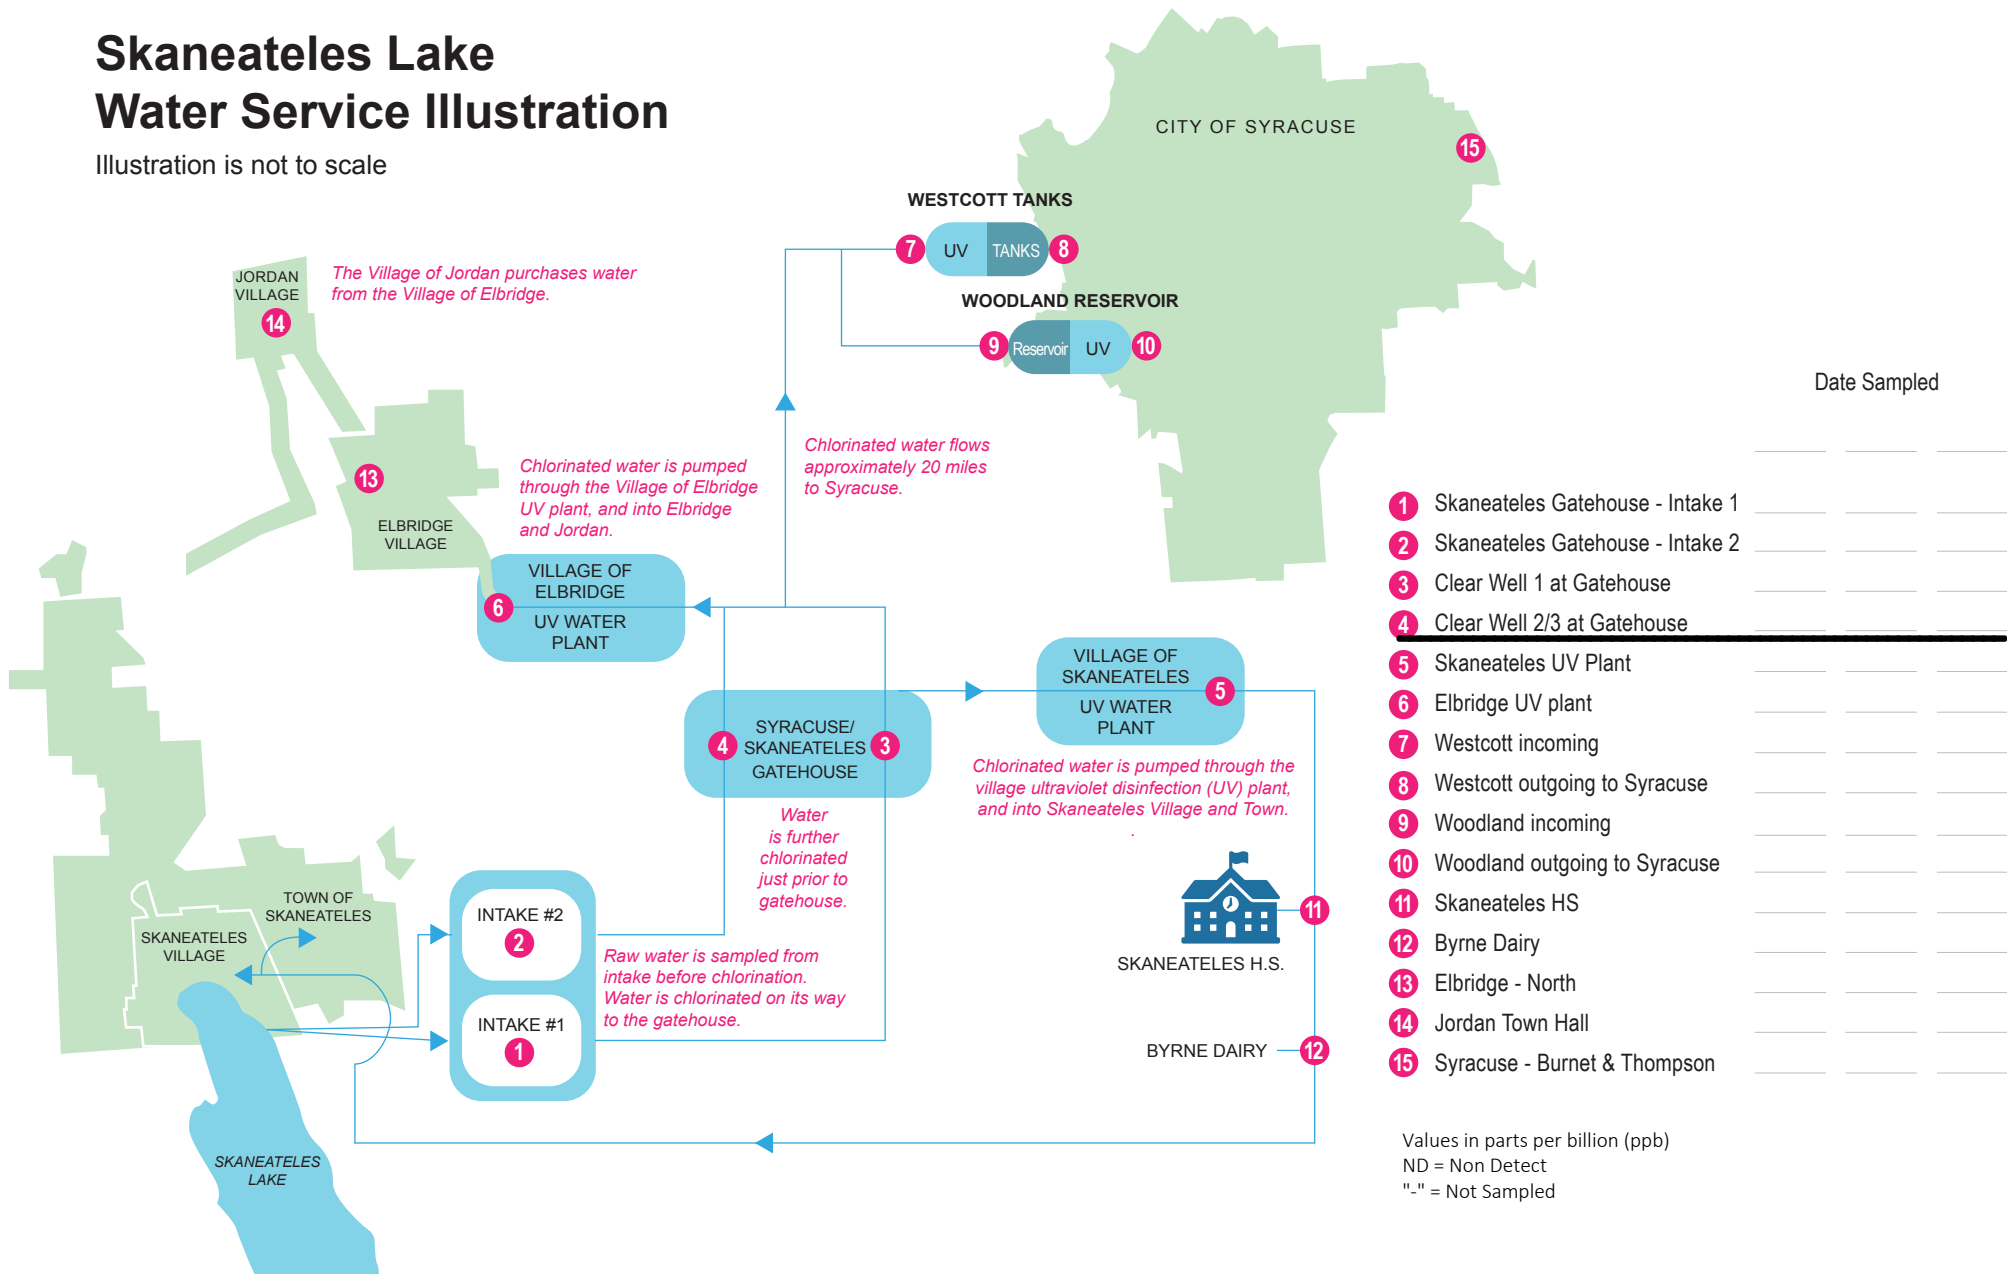

	Date Sampled	
1	Skaneateles Gatehouse - Intake 1	_____
2	Skaneateles Gatehouse - Intake 2	_____
3	Clear Well 1 at Gatehouse	_____
4	Clear Well 2/3 at Gatehouse	_____
5	Skaneateles UV Plant	_____
6	Elbridge UV plant	_____
7	Westcott incoming	_____
8	Westcott outgoing to Syracuse	_____
9	Woodland incoming	_____
10	Woodland outgoing to Syracuse	_____
11	Skaneateles HS	_____
12	Byrne Dairy	_____
13	Elbridge - North	_____
14	Jordan Town Hall	_____
15	Syracuse - Burnet & Thompson	_____

Values in parts per billion (ppb)
 ND = Non Detect
 "-" = Not Sampled